


LORETTO HEIGHTS WELL SUPPLY SYSTEM

Part #1

'WECA WEL


- SYSTEM VALVES
- HYDRANT + VALVES
- BLEW OFF
- WATER MAIN
- PUMP HOUSE

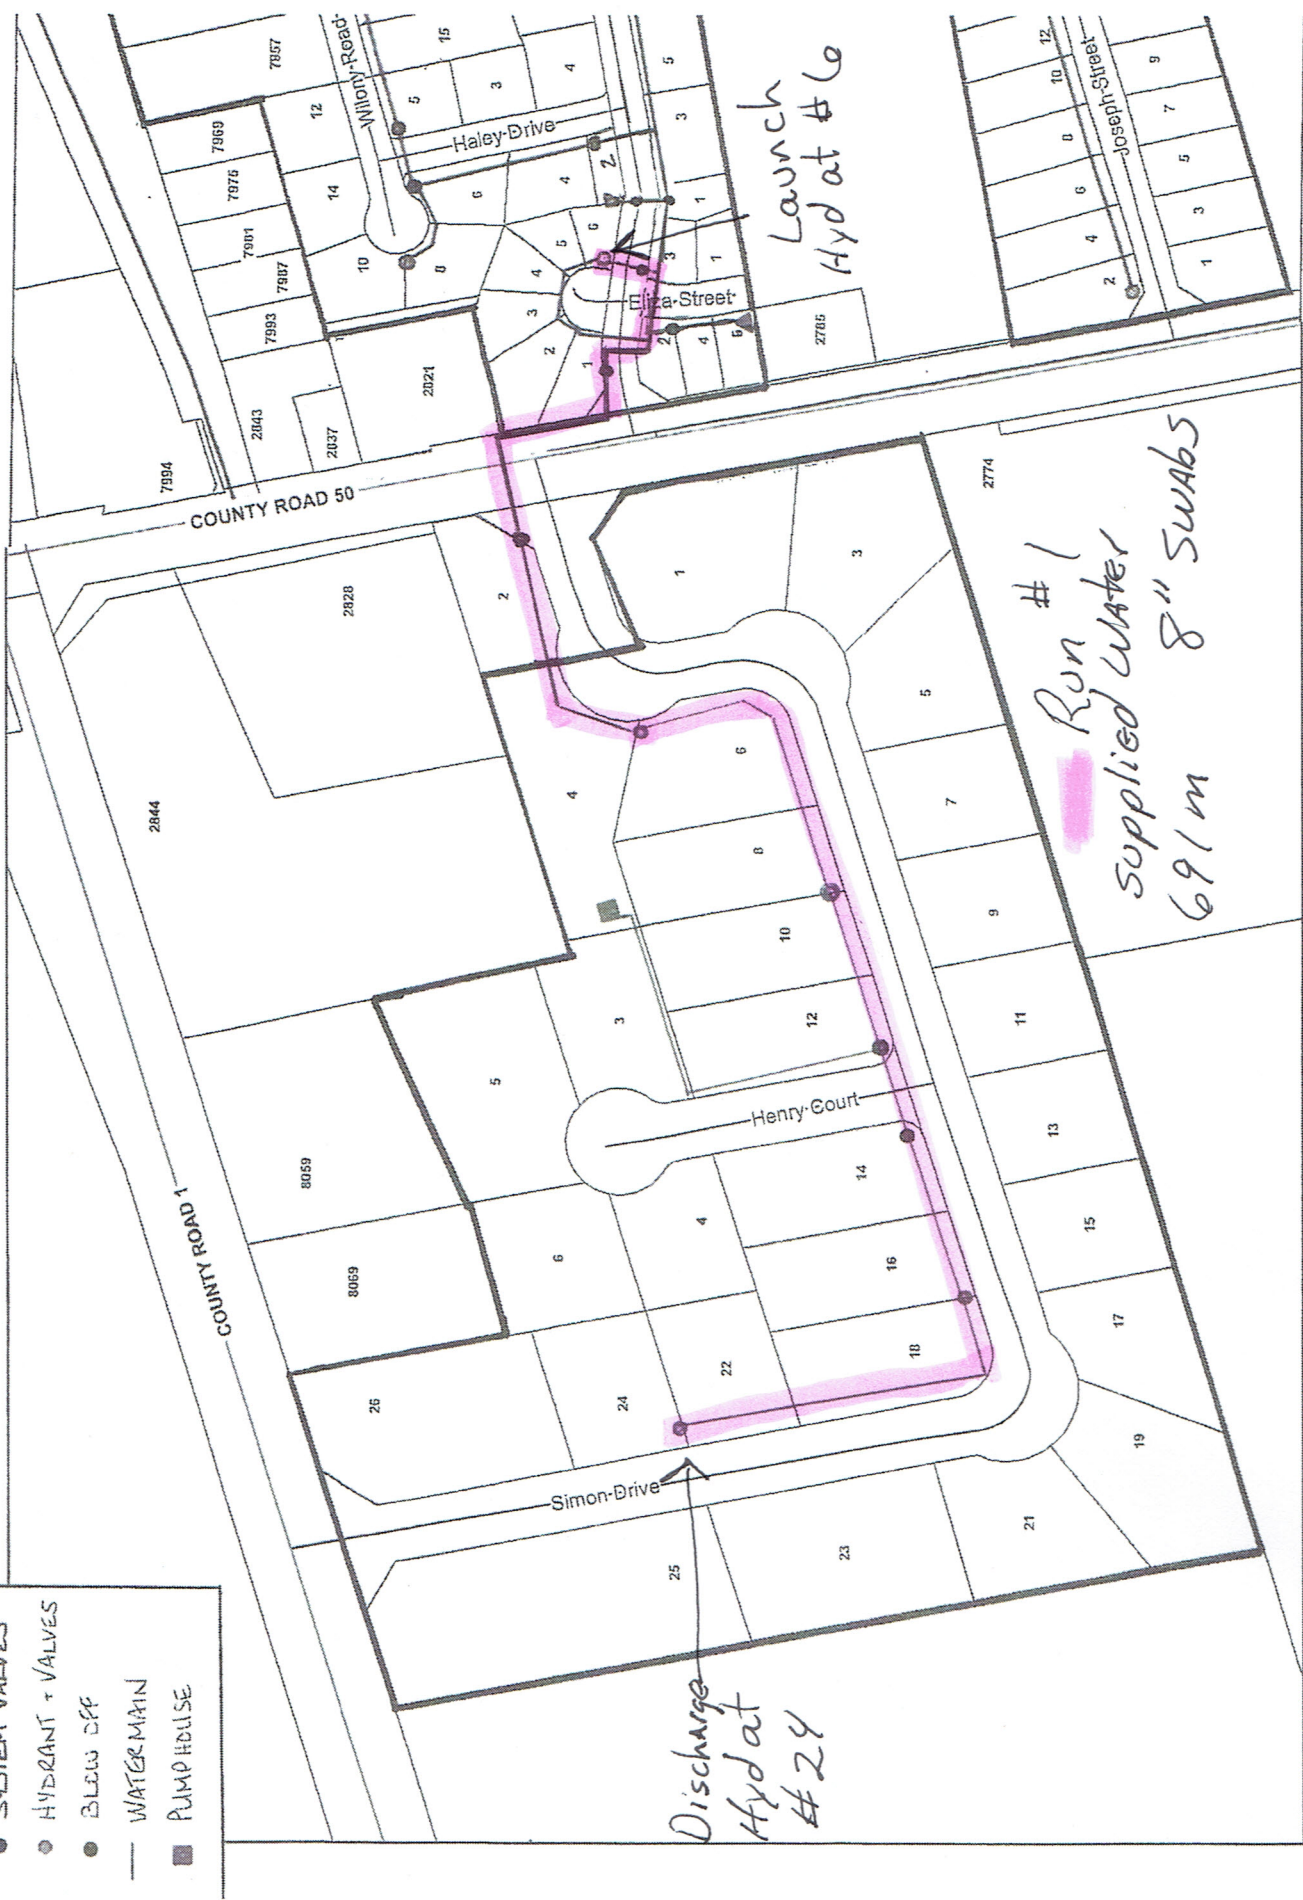

# Loretto Part 2

WECA WELD SUPPLY SYSTEM

SUPPLY SYSTEM

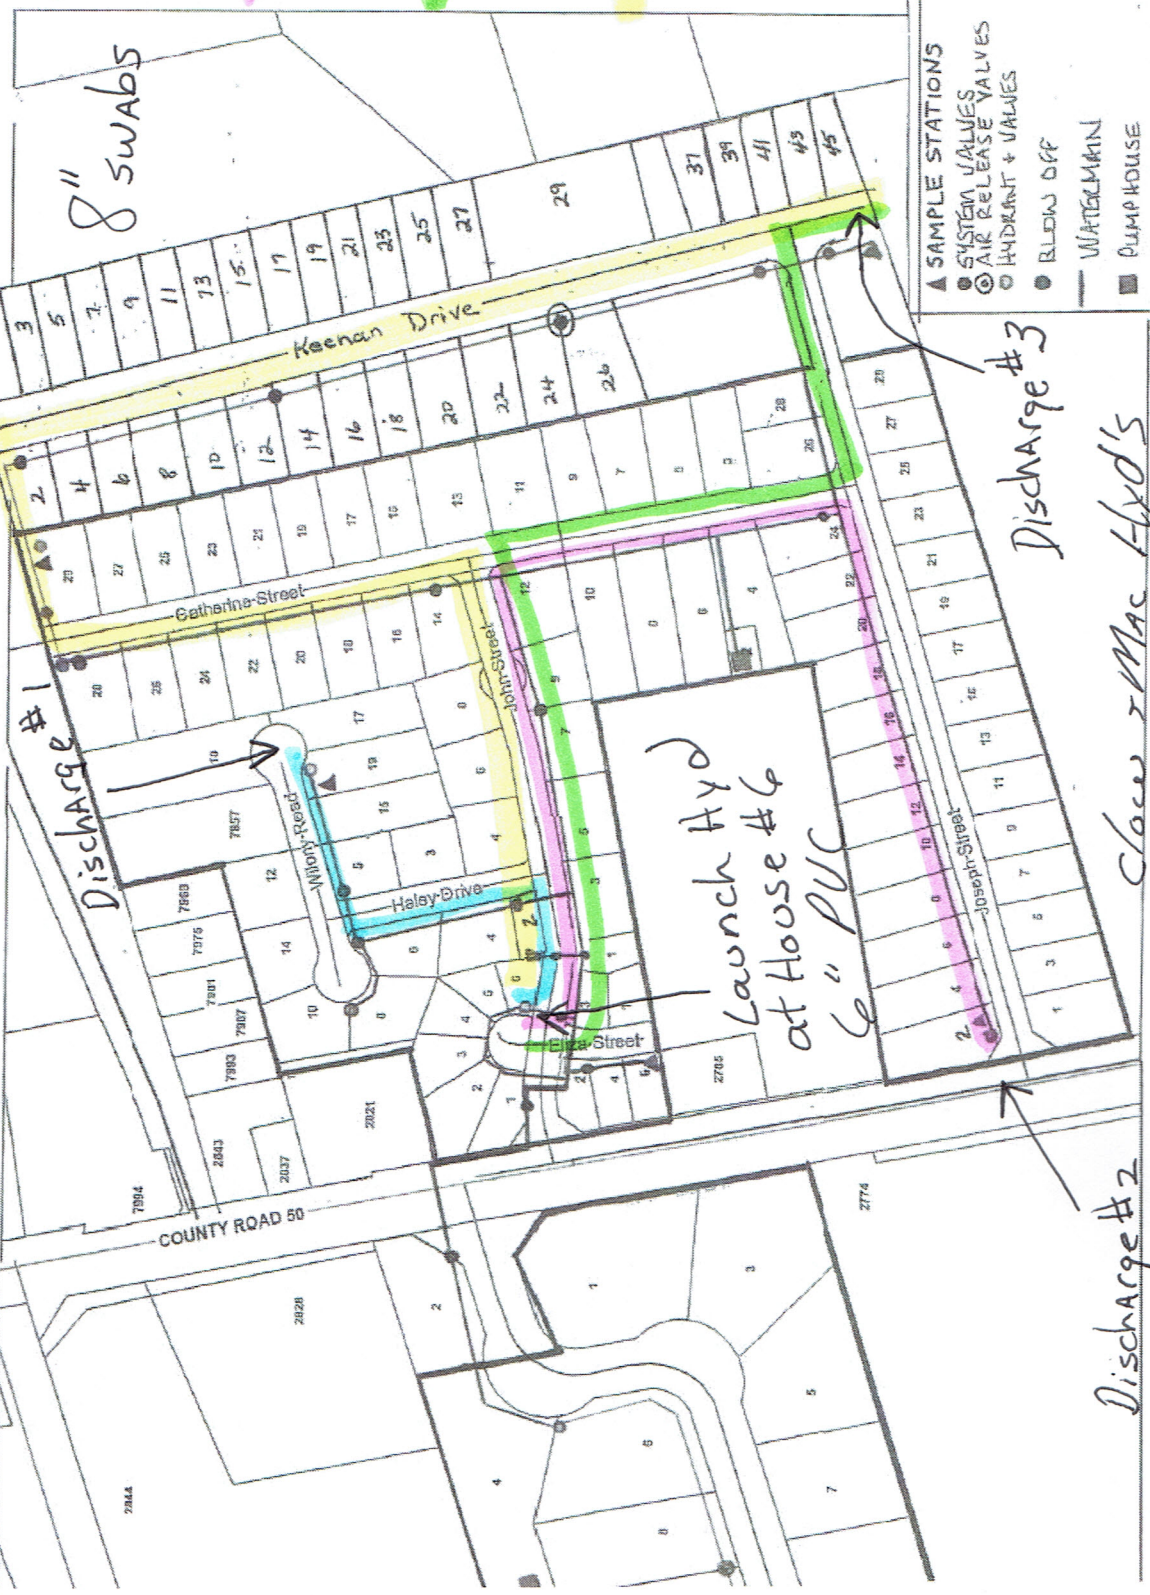

Run #1  
395 m.

Run #2  
950 m

Run #3  
789 m

Run #4  
1370 m.

2 Tankers  
Required  
For Supplied  
Water  
3 loads TOTAL

- ▲ SAMPLE STATIONS
- SYSTEM VALVES
- AIR RELEASE VALVES
- HYDRANT + VALVES
- BLOW OFF
- WATERMAIN
- PUMP HOUSE

8" swabs

Discharge #1

Discharge #3

Launch Hyd  
at House #6  
6" PVC

Discharge #2

Close Mac Hyd's